
HOSHIZAKI

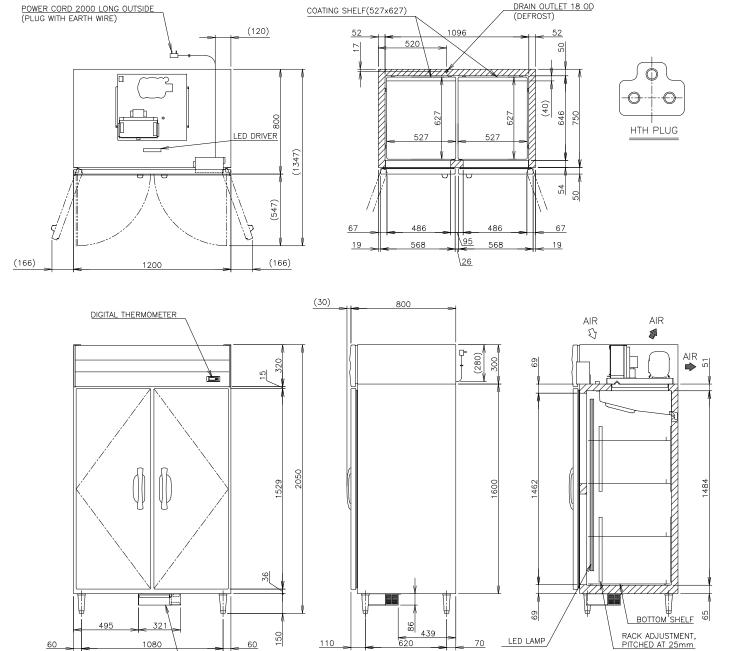

| ITEM | Hoshizaki Reach—in Refrigerator | | | | | | |
|--|---|--|--|--|--|--|--|
| MODEL | HF-128MA-S | | | | | | |
| POWER SUPPLY | | | | | | | |
| AMPERAGE | Rated: 5.6A Starting: 15.6A | | | | | | |
| ELECTRIC | Heater: 474W | | | | | | |
| CONSUMPTION | Defrost: 250W | | | | | | |
| HEAT REJECTION | *W | | | | | | |
| POWER CORD | 2.0m (Plug with Earth Wire) | | | | | | |
| EFFECTIVE CAPACITY | 1047L | | | | | | |
| OUTSIDE DIMENSIONS | 1200mm(W) x 800mm(D) x 2050(-2080)mm(H) | | | | | | |
| INSIDE DIMENSIONS | 1096mm(W) x 646mm(D) x 1484mm(H) | | | | | | |
| EXTERIOR | Stainless Steel, Galvanized Steel(Rear, Bottom) | | | | | | |
| INTERIOR | Stainless Steel, Stainless Pack(Door) | | | | | | |
| INSULATION | Polyurethane Foam | | | | | | |
| INSULATION FOAM BLOWING AGENT | Cyclopentane | | | | | | |
| REFRIGERATION SYSTEM | Forced Air Circulation | | | | | | |
| DEFROST SYSTEM | Heater | | | | | | |
| COMPRESSOR | Hermetic | | | | | | |
| CONDENSER | Wire and Tube type, Air—cooled | | | | | | |
| EVAPORATOR | Fin and Tube type | | | | | | |
| REFRIGERANT | R404A | | | | | | |
| TEMPERATURE CONTROL | Microprocessor (Digital Temp. Indication) Adjustable from -23 to -7°C | | | | | | |
| DEFROST CONTROL | Microprocessor | | | | | | |
| ELECTRIC CIRCUIT PROTECTION | Earth Wire, Circuit Breaker | | | | | | |
| REFRIGERANT CIRCUIT PROTECTION | Motor Protector (Auto-reset) | | | | | | |
| LEG | Plastic Adjustable from 150 to 180mm | | | | | | |
| SHELF | 8 pcs. | | | | | | |
| WEIGHT | 152kg (Gross 184kg) | | | | | | |
| PACKAGE | Carton (Wooden Pallet) 1260mm(W) x 900mm(D) x 2075mm(H) | | | | | | |
| ACCESSORIES | | | | | | | |
| OPERATING CONDITIONS | Ambient Temperature: 5 - 43°C Voltage Range: Rated Voltage ±6% | | | | | | |
| *We reserve the right to make changes in specifications and design without prior notice. | | | | | | | |
| 1 Install the product properly in accordance | | | | | | | |

1. Install the product properly in accordance with the instructions on location, water supply/ drain connections and electrical connections stated in the instruction and installation manuals provided.

Allow 10mm extra space at the installation site to meet any installation requirements (additional spacing is also required for proper air flow and pipe connections).

- 2. The heat rejection is based on the reached pulldown temperature at ambient temperature of
- 3. Product Code: R595-W* (HTH)

EVAPORATING PAN

| APPROV LIAN(| | | HECKED LIU | DESIGNED JIA | DRAWN JIA | | SCALE 1 | /20 | TRIGON | OMETRY |
|-----------------|----------|---------|---------------|-----------------|--------------|------|---------|-----------|--------|---------|
| | * | * | A | * | | DATE | | DRAWING N | | SYMB0L/ |
| | APPROVED | DESIGNE | D SYMBOL | DATE | DATE | | 24.4.2 | D**** | | |